


2-to-1 Transparent Server

With the 2-to-1 Transparent Server, your HMI unit can be a gateway for another computing device, such as a PC, a target panel, or a panel of other brand, to access the same PLC. See the following diagrams to know the possible applications.

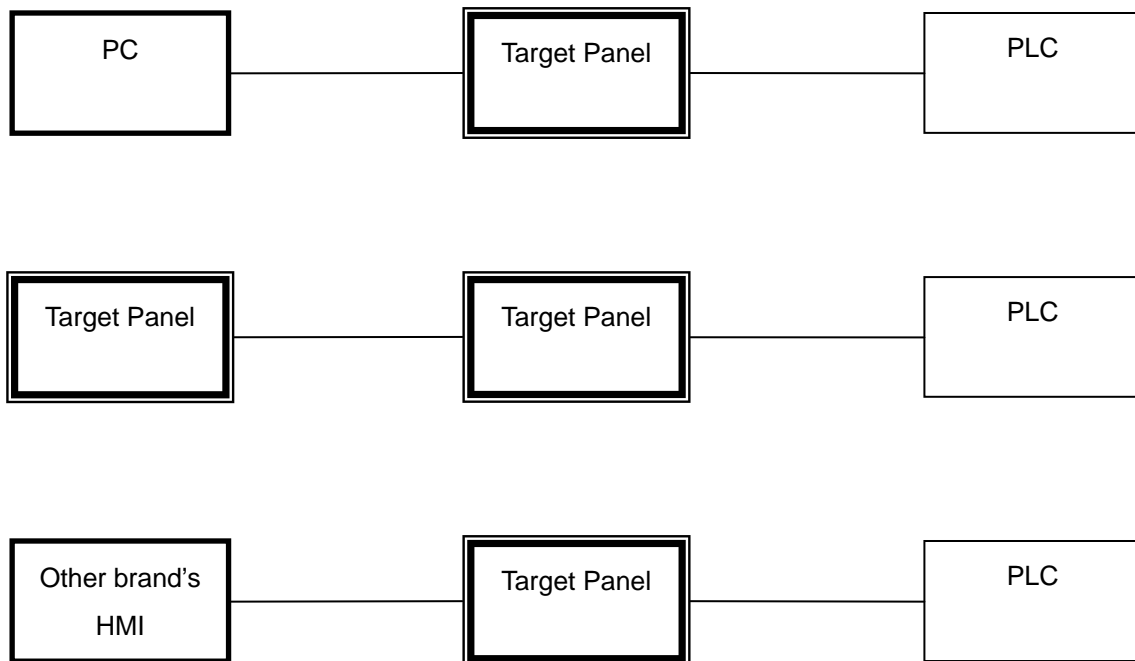

Any kinds of PLC whose communication protocol is of the request-reply type can be supported. Ask your local representative to check if your PLC is supported. Note that the communication parameters (baud rate, number of data bits, number of stop bits, and type of parity check) of the computing device and the communication parameters of the 2-to-1 Transparent Server should be identical.

Filename of 2-to-1 Transparent Server: C01062.mod

Currently supported protocol: PanelMaster ModBus Device/Slave (RTU)